



12" WIDE 16 GA GALVANIZED
ANCHOR CLIPS. SPACING
DETERMINED ACCORDING TO
DESIGN PRESSURE REQUIREMENTS

1-1/4" RING SHANK ROOFING
NAILS PROVIDED, 12" O.C.


8" WIDE CONCEALED SPLICE
PLATE WITH FACTORY APPLIED
DUAL NON-CURING SEALANT
STRIPS AT EACH JOINT

COPING COVER, (12' LENGTHS)
ANSI/SPRI/ FM 4435/ ES-1 MAXIMUM
DESIGN PRESSURE 297 PSF
(HORIZONTAL) 513 PSF (VERTICAL),
WHEN INSTALLED AS TESTED


#10 X 1-1/2" STAINLESS
STEEL FASTENERS PROVIDED,
TO SECURE ANCHOR CLIPS

MEMBRANE SECURED AT FACE
OF WALL WITH NAILS

IB MEMBRANE

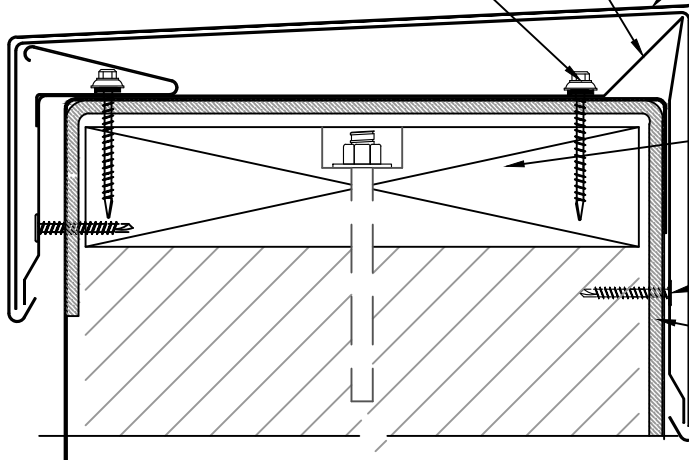

ANCHOR CLIP PROFILE ON
WALLS GREATER THAN 14"



NOTES:

1. SINGLE COURSE WALL FLASHING MAXIMUM HEIGHTS:
 - A. 18' FOR MECHANICALLY ATTACHED FLASHING INDUCTION WELDED OR 60' FOR FULLY ADHERED FLASHINGS.
 - B. FOR WALLS EXCEEDING MAXIMUM HEIGHTS, REFER TO APPLICABLE TALL WALL DETAILS.
2. SECURE FLASHINGS AND METAL WORK IN ACCORDANCE WITH IB SPECIFICATIONS AND FLASHING SECUREMENT TABLE.
3. SEALANTS AND CAULKING REQUIRE PERIODIC OWNER MAINTENANCE.

APPROVED SUBSTRATE / SEPARATION:

NEW CONSTRUCTION - FULLY ADHERED, INDUCTION WELDED, AND MECHANICALLY ATTACHED

- 1/2" PLYWOOD, 7/16" OSB, 1/2" APPROVED GYPSUM COVER BOARD, POURED / PRECAST CONCRETE, OR CEMENT BLOCK / MASONRY WALLS.

MECHANICALLY ATTACHED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS

- FULL SEPARATION REQUIRED WITH MINIMUM 1/2" PLYWOOD, 1/4" APPROVED GYPSUM COVER BOARD, 7/16" OSB, OR APPROVED INDUCTION WELDED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS

- FULL SEPARATION REQUIRED WITH MINIMUM 1/4" APPROVED GYPSUM COVER BOARD

FULLY ADHERED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS

- FULL SEPARATION REQUIRED WITH MINIMUM 1/2" PLYWOOD, 1/4" APPROVED GYPSUM COVER BOARD, OR 7/16" OSB

Scale: NTS	Detail Name: <i>Parapet Coping - Metal Era Perma Tite Gold Coping</i>	Detail Number: <i>PT - 07</i>
Submitted By: Address: Telephone:	Project: Address:	